

**Center Joint Unified School District
Project No. 26-05
North Country Elementary School
Classroom Roofing Project
ADDENDUM NO. 2**

April 20, 2026

Owner: Center Joint Unified School District
8408 Watt Avenue
Antelope, CA 95843

Project Manager: Capital Program Management, Inc.
1851 Heritage Lane, Suite 210
Sacramento, CA 95815

This Addendum has been prepared to clarify, modify, delete, or add to the drawings and/or specifications for the above referenced project, and revisions to items listed here shall supersede description thereof prior to the above stated date. All conditions not specifically referenced here shall remain the same. It is the obligation of the Prime Contractor to make subcontractors aware of any items herein that may affect submitted bids.

Acknowledge receipt of this addendum by inserting its number and date in the bidding documents. Failure to do so may subject bidder to disqualification.

All addenda items refer to the plans and specifications unless specifically noted otherwise.

TOTAL PAGES IN THIS ADDENDUM (including attachments): **28**

**Center Joint Unified School District
Project No. 26-05
North Country Elementary School
Classroom Roofing Project
ADDENDUM NO. 2**

Part A. BIDDING AND CONTRACT REQUIREMENTS

- 1.1 The bid date has not changed. Bids are due Thursday, April 28 by 2:00:00 p.m. at the Center Joint Unified School District – Facilities Department, 8408 Watt Avenue, Antelope, CA 95843.

Part B. TECHNICAL REQUIREMENTS

- 2.1 Per specification 01 11 00, 1.3 Scope of Work, ADD the following to the scope of work item 1.3 D.2. All materials considered to be hazardous should be abated prior to complete removal and this work should be performed by a trained & certified contractor. Please refer to the attached reference material issued by Entek and dated April, 2026.

Part C. DRAWINGS

- 3.1 None

Part D. RESPONSES TO CONTRACTOR QUESTIONS

- 4.1 None

ATTACHMENTS

- 5.1 Roofing Hazmat Reference information dated April, 2026.

End of Addendum

Report for:

Mr. Gerald Moralez, GeraldMoralez, Francisco Rodriguez, Jack Trammell, jacktrammell
Entek Consulting Group
3435 American River Drive
Suite C
Sacramento, CA 95864

Regarding: Eurofins Built Environment Testing West, LLC
Project: 26-8163; CJUSD, North Country ES Roofing Survey, 3901 Little Rock Drive, Antelope, CA
EML ID: 4495026

Approved by:

Dates of Analysis:

Asbestos PLM: 04-15-2026 and 04-16-2026



Approved Signatory
James Schatz

Service SOPs: Asbestos PLM (EPA 40CFR App E to Sub E of Part 763 & EPA 600/R-93-116, EBET-PLM-SOP83921)
NVLAP Lab Code 600397-0

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. The results relate only to the samples as received and tested. The results include an inherent uncertainty of measurement associated with estimating percentages by polarized light microscopy. Measurement uncertainty data for sample results with >1% asbestos concentration can be provided when requested.

Eurofins Built Environment Testing West, LLC ("the Company"), a member of the Eurofins Built Environment Testing group of companies, shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, Gerald Morales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Total Samples Submitted: 56

Total Samples Analyzed: 56

Total Samples with Layer Asbestos Content > 1%: 6

Location: ECG-26-8163-01A, Black, Asphaltic Roofing, Southside, Sequoia Building. Lab ID-Version‡: 22598999-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-01B, Black, Asphaltic Roofing, Northside, Sequoia Building. Lab ID-Version‡: 22599000-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-02A, Tan, Penetration Mastic on Flashing, Southside of Sequoia Building. Lab ID-Version‡: 22599001-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-02B, Tan, Penetration Mastic on Flashing, Eastside of Sequoia Building. Lab ID-Version‡: 22599002-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
 C/O: Mr. Gerald Morales, Gerald Morales, Francisco
 Rodriguez, Jack Trammell, jacktrammell
 Re: 26-8163; CJUSD, North Country ES Roofing
 Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Location: ECG-26-8163-03A, White, Single Ply Roofing Membrane, Southside, Office Building.

Lab ID-Version‡: 22599003-1

Sample Layers	Asbestos Content
White Roofing Material	ND
White Drywall with Brown Paper	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Cellulose 5% Glass Fibers
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-03B, White, Single Ply Roofing Membrane, Center of Upper Roof, Office Building.

Lab ID-Version‡: 22599004-1

Sample Layers	Asbestos Content
White Roofing Material	ND
White Drywall with Brown Paper	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Cellulose 5% Glass Fibers
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-03C, White, Single Ply Roofing Membrane, Eastside, Office Building.

Lab ID-Version‡: 22599005-1

Sample Layers	Asbestos Content
White Roofing Material	ND
White Drywall with Brown Paper	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Cellulose 5% Glass Fibers
Sample Composite Homogeneity:	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, GeraldMorales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Location: ECG-26-8163-04A, White, Roofing Patch, Southside, Office Building.

Lab ID-Version‡: 22599006-1

Sample Layers	Asbestos Content
White Roofing Material	ND
White Drywall with Brown Paper	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Cellulose 5% Glass Fibers
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-04B, White, Roofing Patch, Eastside, Office Building.

Lab ID-Version‡: 22599007-1

Sample Layers	Asbestos Content
White Roofing Material	ND
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-05A, Grey, Penetration Mastic, Southside, Office Building.

Lab ID-Version‡: 22599008-1

Sample Layers	Asbestos Content
Gray Mastic	ND
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-05B, Grey, Penetration Mastic, Eastside, Office Building.

Lab ID-Version‡: 22599009-1

Sample Layers	Asbestos Content
Gray Mastic	ND
Sample Composite Homogeneity:	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Entek Consulting Group
 C/O: Mr. Gerald Morales, GeraldMorales, Francisco
 Rodriguez, Jack Trammell, jacktrammell
 Re: 26-8163; CJUSD, North Country ES Roofing
 Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
 Date of Receipt: 04-15-2026
 Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Location: ECG-26-8163-06A, Grey Roofing Tape At Base Of Ladders, Westside of Office Building.

Lab ID-Version‡: 22599010-1

Sample Layers	Asbestos Content
Silver Tape	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-06B, Grey Roofing Tape At Base Of Ladders, Eastside of Office Building.

Lab ID-Version‡: 22599011-1

Sample Layers	Asbestos Content
Silver Tape	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-07A, Black, Roofing Patch, Southside of Sequoia Building.

Lab ID-Version‡: 22599012-1

Sample Layers	Asbestos Content
Black Roofing Material with Rocks	ND
Black Roofing Mastic	ND
Black Roofing Tar and Felt	ND
Brown Wood	ND
Composite Non-Asbestos Content:	10% Cellulose 10% Glass Fibers
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
 C/O: Mr. Gerald Morales, Gerald Morales, Francisco
 Rodriguez, Jack Trammell, jacktrammell
 Re: 26-8163; CJUSD, North Country ES Roofing
 Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT**Location: ECG-26-8163-07B, Black, Roofing Patch, Southeast Side of Sequoia Building.**

Lab ID-Version‡: 22599013-1

Sample Layers	Asbestos Content
Black Roofing Material with Rocks	ND
Black Roofing Mastic	ND
Black Roofing Tar and Felt	ND
Brown Wood	ND
Composite Non-Asbestos Content:	10% Cellulose 10% Glass Fibers
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-08A, Black, Asphaltic Roofing, Southside, Willow Building.

Lab ID-Version‡: 22599014-1

Sample Layers	Asbestos Content
Gray Rock	ND
Black Roofing Material	ND
Black Roofing Tar and Felt	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Cellulose 10% Glass Fibers
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-08B, Black, Asphaltic Roofing, Northeast Side, Willow Building.

Lab ID-Version‡: 22599015-1

Sample Layers	Asbestos Content
Gray Rock	ND
Black Roofing Material	ND
Black Roofing Tar and Felt	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Cellulose 10% Glass Fibers
Sample Composite Homogeneity:	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, GeraldMorales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Location: ECG-26-8163-09A, Tan Penetration Mastic, On Flashing, Northeast Side of Willow Building.

Lab ID-Version‡: 22599016-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Black Roofing Material (Trace)	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-09B, Tan Penetration Mastic, On Flashing, Westside of Willow Building.

Lab ID-Version‡: 22599017-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Black Roofing Material (Trace)	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-10A, Black, Roofing Patch, Center, Willow Building.

Lab ID-Version‡: 22599018-1

Sample Layers	Asbestos Content
Black Roofing Material with Rocks	ND
Black Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-10B, Black, Roofing Patch, Westside, Willow Building

Lab ID-Version‡: 22599019-1

Sample Layers	Asbestos Content
Black Roofing Material with Rocks	ND
Black Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
 C/O: Mr. Gerald Morales, Gerald Morales, Francisco
 Rodriguez, Jack Trammell, jacktrammell
 Re: 26-8163; CJUSD, North Country ES Roofing
 Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT**Location: ECG-26-8163-11A, Black, Asphaltic Roofing, Westside, Restroom Building.**

Lab ID-Version‡: 22599020-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-11B, Black, Asphaltic Roofing, Northeast Side, Restroom Building.

Lab ID-Version‡: 22599021-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-12A, Tan, Penetration Mastic on Flashing, Westside, Restroom Building.

Lab ID-Version‡: 22599022-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-12B, Tan, Penetration Mastic on Flashing, Northeast Side, Restroom Building.

Lab ID-Version‡: 22599023-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity:	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group

C/O: Mr. Gerald Morales, GeraldMorales, Francisco

Rodriguez, Jack Trammell, jacktrammell

Re: 26-8163; CJUSD, North Country ES Roofing

Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT**Location: ECG-26-8163-13A, Black, Asphaltic Roofing, Westside, Cypress Building.**

Lab ID-Version‡: 22599024-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-13B, Black, Asphaltic Roofing, Center, Cypress Building.

Lab ID-Version‡: 22599025-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-13C, Black, Asphaltic Roofing, Eastside, Cypress Building.

Lab ID-Version‡: 22599026-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity:	Good

Location: ECG-26-8163-14A, Tan, Penetration Mastic on Flashing, Cypress Building.

Lab ID-Version‡: 22599027-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity:	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, Gerald Morales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Location: ECG-26-8163-14B, Tan, Penetration Mastic on Flashing, Cypress Building. Lab ID-Version‡: 22599028-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-15A, Black, Asphaltic Roofing, Northside, Northside, Kindergarten Building. Lab ID-Version‡: 22599029-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Composite Non-Asbestos Content:	20% Glass Fibers
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-15B, Black, Asphaltic Roofing, Northside, Westside, Kindergarten Building. Lab ID-Version‡: 22599030-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Composite Non-Asbestos Content:	20% Glass Fibers
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-16A, Tan, Penetration Mastic, On Flashing, Northside of Kindergarten Building. Lab ID-Version‡: 22599031-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group

C/O: Mr. Gerald Morales, GeraldMorales, Francisco

Rodriguez, Jack Trammell, jacktrammell

Re: 26-8163; CJUSD, North Country ES Roofing

Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT**Location: ECG-26-8163-16B, Tan, Penetration Mastic, On Flashing, Northside of Kindergarten Building.**

Lab ID-Version‡: 22599032-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-17A, Black, Asphaltic Roofing, Eastside of Oak Building.

Lab ID-Version‡: 22599033-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-17B, Black, Asphaltic Roofing, Northside of Oak Building.

Lab ID-Version‡: 22599034-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Composite Non-Asbestos Content:	20% Glass Fibers
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-18A, Tan, Penetration Mastic, Eastside of Oak Building.

Lab ID-Version‡: 22599035-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group

C/O: Mr. Gerald Morales, GeraldMorales, Francisco

Rodriguez, Jack Trammell, jacktrammell

Re: 26-8163; CJUSD, North Country ES Roofing

Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT**Location: ECG-26-8163-18B, Tan, Penetration Mastic, Northwest Side of Oak Building.**

Lab ID-Version‡: 22599036-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-19A, Black, Roofing Patch, Northside of Oak Building.

Lab ID-Version‡: 22599037-1

Sample Layers	Asbestos Content
Black Roofing Material with Rocks	ND
Black Roofing Mastic	ND
Black Roofing Tar and Felt	ND
Brown Wood	ND
Composite Non-Asbestos Content:	10% Cellulose 10% Glass Fibers
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-19B, Black, Roofing Patch, Eastside of Oak Building.

Lab ID-Version‡: 22599038-1

Sample Layers	Asbestos Content
Black Roofing Material with Rocks	ND
Black Roofing Mastic	ND
Black Roofing Tar and Felt	ND
Brown Wood	ND
Composite Non-Asbestos Content:	10% Cellulose 10% Glass Fibers
Sample Composite Homogeneity: Good	

**Location: ECG-26-8163-20A, Black/Grey Penetration Mastic, Around Flue Pipes/
Electrical Conduit, Eastside, Oak Building.**

Lab ID-Version‡: 22599039-1

Sample Layers	Asbestos Content
Black Mastic	3% Chrysotile
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, GeraldMorales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

**Location: ECG-26-8163-20B, Black/Grey Penetration Mastic, Around Flue Pipes/
Electrical Conduit, Center, Oak Building.**

Lab ID-Version‡: 22599040-1

Sample Layers	Asbestos Content
Black Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-21A, Black, Asphaltic Roofing, Westside, Maple Building.

Lab ID-Version‡: 22599041-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-21B, Black, Asphaltic Roofing, Eastside, Maple Building.

Lab ID-Version‡: 22599042-1

Sample Layers	Asbestos Content
Black Roofing Material	ND
Black Roofing Mastic	ND
Brown Wood	ND
Composite Non-Asbestos Content:	15% Glass Fibers 10% Cellulose
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-22A, Tan, Penetration Mastic, Eastside, Maple Building.

Lab ID-Version‡: 22599043-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, GeraldMorales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

Location: ECG-26-8163-22B, Tan, Penetration Mastic, Westside, Maple Building.

Lab ID-Version‡: 22599044-1

Sample Layers	Asbestos Content
Tan Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-23A, Black, Penetration Mastic, Around Flue Pipes/Electrical Conduit, Westside, Maple Building.

Lab ID-Version‡: 22599045-1

Sample Layers	Asbestos Content
Black Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-23B, Black, Penetration Mastic, Around Flue Pipes/Electrical Conduit, Center, Maple Building.

Lab ID-Version‡: 22599046-1

Sample Layers	Asbestos Content
Black Mastic	ND
Sample Composite Homogeneity: Good	

Location: ECG-26-8163-24A, Black, Penetration Mastic, Around Flue Pipes/Electrical Conduit, Center, Sequoia Building.

Lab ID-Version‡: 22599047-1

Sample Layers	Asbestos Content
Black Mastic	ND
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, GeraldMorales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

**Location: ECG-26-8163-24B, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Northwest Side, Sequoia Building.**

Lab ID-Version‡: 22599048-1

Sample Layers	Asbestos Content
Black Mastic	3% Chrysotile
Sample Composite Homogeneity: Good	

**Location: ECG-26-8163-25A, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Southwest Side of Willow Building.**

Lab ID-Version‡: 22599049-1

Sample Layers	Asbestos Content
Black Mastic	3% Chrysotile
Sample Composite Homogeneity: Good	

**Location: ECG-26-8163-25B, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Southeast Side of Willow Building.**

Lab ID-Version‡: 22599050-1

Sample Layers	Asbestos Content
Black Mastic	3% Chrysotile
Sample Composite Homogeneity: Good	

**Location: ECG-26-8163-26A, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Southeast Side, Cypress Building**

Lab ID-Version‡: 22599051-1

Sample Layers	Asbestos Content
Black Mastic	ND
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Morales, GeraldMorales, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026
Date of Receipt: 04-15-2026
Date of Report: 04-16-2026

ASBESTOS PLM REPORT

**Location: ECG-26-8163-26B, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Northwest Side, Cypress Building.**

Lab ID-Version‡: 22599052-1

Sample Layers	Asbestos Content
Black Mastic	ND
Sample Composite Homogeneity: Good	

**Location: ECG-26-8163-27A, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Northeast Side, Kindergarten Building**

Lab ID-Version‡: 22599053-1

Sample Layers	Asbestos Content
Black Mastic	3% Chrysotile
Sample Composite Homogeneity: Good	

**Location: ECG-26-8163-27B, Black, Penetration Mastic, Around Flue Pipes/Electrical
Conduit, Northwest Side, Kindergarten Building**

Lab ID-Version‡: 22599054-1

Sample Layers	Asbestos Content
Black Mastic	3% Chrysotile
Sample Composite Homogeneity: Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins Built Environment Testing West, LLC

180 Blue Ravine Rd, Folsom, CA 95630

(833) 465-5857 www.eurofinsus.com/Built

Client: Entek Consulting Group
C/O: Mr. Gerald Moralez, GeraldMoralez, Francisco
Rodriguez, Jack Trammell, jacktrammell
Re: 26-8163; CJUSD, North Country ES Roofing
Survey, 3901 Little Rock Drive, Antelope, CA

Date of Sampling: 04-14-2026

Date of Receipt: 04-15-2026

Date of Report: 04-16-2026

ASBESTOS PLM REPORT

PROJECT ANALYST AND SIGNATORY REPORT

Project Analyst



Analyst: Samantha Pierce

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Built Environment Testing



EPA SW-846 LEAD-TTLC

9697
 Gerald Moralez
 Entek Consulting Group, Inc.
 3435 American River Dr., Ste. C
 Sacramento, CA 95864

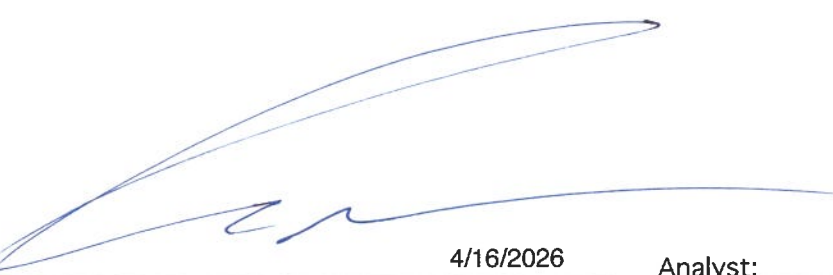
PROJECT:

Project ID: ECG-26-8163
 North Country Elementary School
 Roofing Survey

Micro Log In **4496688**
 Total Samples 2
 Date Sampled 04/14/2026
 Date Received 04/16/2026
 Date Analyzed 04/16/2026

Sample ID	Lead Concentration, ppm	RDL, ppm	Comments
Client ECG-26-8163-01Pb Micro 4496688-01 GREY, MALLEABLE METAL, WIRE COVERING ASSOCIATED WITH HVAC UNITS, WESTSIDE OF OFFICE	510000	50000	
Client ECG-26-8163-02Pb Micro 4496688-02 GREY, MALLEABLE METAL, FLUE PIPE JACKET, CYPRESS BUILDING	640000	50000	

Technical Supervisor: _____


 Long T. Nguyen, Chemistry Supervisor

4/16/2026

Date Reported

Analyst: _____

RN

Samples are analyzed by Flame Atomic Absorption Spectrometry (FLAAS) using SOP 23-Soil (in accordance with EPA Methods 3050B for Acid Digestion (SW 846, 3rd edition, 2007) and 7420 for Analysis (SW-846, 3rd edition, 2007)). NOTE: Water samples are analyzed by FLAA in accordance with Method 3111B (Standard Methods for the Examination of Water and Wastewater, 18th edition). Unless otherwise indicated on this report, all required Quality Control samples have been determined to be in control prior to releasing these analytical results. Unless otherwise stated in this report, all samples were received in acceptable condition for analysis. Note: due to software limitations, the number of reported significant figures does not necessarily reflect the uncertainty of the analysis. This report must not be reproduced except in full without the approval of Eurofins, and pertains only to the samples analyzed as received. Unit explanations: mg = milligrams; kg = kilograms; ppm = parts per million. L = liters. RDL = Report Detection Limit. Note: mg / Kg is the same as ppm for solids, and mg/L is the same as ppm for water.

WEATHER	None	Fog	Rain	Snow	Wind	Clear
	Light					
	Moderate					
	Heavy					
LEVEL						

CONTACT INFORMATION

Company: Entek Consulting Group, Inc
 Address: 3435 American River Drive, Sac, CA 95864
 Contact: Gerald Moralez
 Phone: 916-899-8129
 Special Instructions:

PROJECT INFORMATION

Project ID: ECG-26-8163
 Project Description: North Country Elementary School, Roofing Survey
 Project Zip Code: 95843
 Sampling Date/Time: 4/14/26
 Sampled By: Gerald Moralez
 PO Number: 26-8163

TURN AROUND TIME CODES - (TAT)

STD - Standard (Default) Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.
 ND - Next Business Day
 SD - Same Business Day
 WH - Weekend/Holiday/ASAP

SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)
ECG-26-8163-01 Pb	Grey, Malleable Metal, Wire Covering, Associated With HVAC Units, Warehouse of Office	B	SD		
ECG-26-8163-02 Pb	Grey, Malleable Metal, Flue Pipe Jacket, Cypress Building.	B	SD		

SAMPLE TYPE CODES				RELINQUISHED BY	DATE & TIME
A1S - Andersen	ST - Spore Trap	T - Tape	O - Other:	<i>Gerald Moralez</i>	4/15/26
SAS - Surface Air Sampler	SW - Swab	SO - Soil			
CP - Contact Plate	B - Bulk	D - Dust			
NP - Non-potable Water	P - Potable Water				

REQUESTED SERVICES

Non-Culturabile		Culturabile		Other Requests	
Spore Trap	Direct Microscopic Exam (Qualitative)	Andersen, SAS, Swab, Water, Bulk, Dust, Soil, Contact Plate	OTHER: (please specify test)	Asbestos Bulk - PLM	Asbestos In Air - PCM Airborne Fiber Count (NIOSH 7400)
Tape, Swab, Bulk	Quantitative spore count direct exam	1-Media Surface Fungi (Genus ID + Asp. spp.)	Quantitray-Sewage Screen	Asbestos Bulk - PLM	Asbestos In Air - PCM Airborne Fiber Count (NIOSH 7400)
	Dust Characterization	Culturable Air Fungi (Genus ID + Asp. spp.)	Total Coliform, E.coli (Presence/Absence)	Lead (Pb) - Flame AA	PCR (please specify test)
	Other biological particles - supplement	Gram Stain and Counts (Culturable Air and Surface Bacteria)	Legionella culture	Asbestos Bulk - PLM	OTHER (please specify test)



